


Minimum wire size of 18 AWG wire should be used for all field installed control wiring.

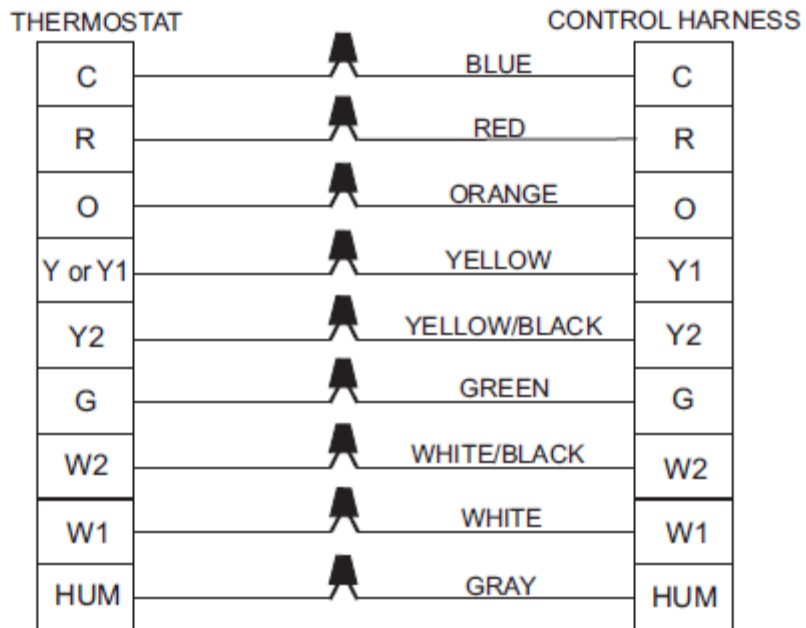

**NOTE:**  
Heat Anticipator should be set at 0.35 AMPS for all models.

A0560-001

**FIGURE 6:** Typical Field Control Wiring Diagram For Dual Fuel Models